



**Typical Specifications For  
Modulating MicoFlame – Hydronic Heating Boilers  
Models MF(N),(P)H 2010 – 4000, Non-Condensing  
Models MF(N),(P)H 2012 – 4002, Condensing**

The heating boiler shall be a CAMUS MicoFlame model \_\_\_\_\_ having an input rating of \_\_\_\_\_ Btu (kw) /hr. and \_\_\_\_\_ Btu (kw)/hr output for hydronic heating and shall be operated on Natural gas or L.P. gas. The boiler shall be capable of firing down to 40% of rated input for models 2010 – 4000.

The heating boiler shall be design/certified by CSA International and shall meet the requirements of ANSI Z21.13b-2007 & CSA 4.9b-2007. The heating boiler shall be optionally vented as a Category I conventional appliance or a category II condensing appliance.

**Combustion Chamber:**

The combustion chamber shall be fully enclosed by high temperature fiberboard refractory, which is of modular interlocking construction for ease of replacement.

**Burner:**

The burner shall be constructed of high heat temperature Stainless Steel with knitted metal fiber to provide modulating firing rates. The burner shall provide equal distribution of heat through the entire heat exchanger. A window view port shall be provided for visual inspection of the boiler during firing. Maximum input per burner shall be 1,000,000 BTU/hr.

**Heat Exchanger:**

The heat exchanger shall be suitable for a M.A.W.P. of 160 psig (1100 kPa) and shall be of a two pass design employing integrally finned 7/8" copper tubes. All castings shall be bronze. A pressure relief valve of \_\_\_\_\_ lb/hr shall be furnished with the heater. There shall be ready access to the heat exchanger to permit internal and external inspection and cleaning of the tubes.

**Controls:**

Standard controls to include factory mounted hi-limit and operator controls, on/off switch and 24 VAC class 2 transformer and light display package. The SmartFlame 78-0017 electronic modulating control to be accurate to 1°F (0.5°C). The control shall also provide readouts of inlet/outlet temperatures and delta T as well as accumulated run hours. The control shall have 8 preset modes to allow operation of the heater as hydronic heating, DHW or remote operation through an analog 0-10VDC signal.

On/off switch and full diagnostic light package are included. Flow switch is included loose.

**Firing Mode:**

The heater shall operate as a fully modulating unit with a 5:2 turn down ratio.

**Gas Train:**

The gas train shall consist of a one to one air/gas ratio control valve, dual main valve seats, a pilot valve and pilot regulator.

**Ignition Module:**

The ignition module shall provide for proved ignition of intermittent pilot and continuous retrieval. Trial for ignition shall be a minimum of 15 seconds with 5 minutes between retrievals.


**External Jacket and Fasteners:**

The external jacket shall be of stainless and enameled steel panels assembled with crimplite non-strip self tap screws.

# SUBMITTAL DATA SHEET – MICROFLAME

Engineer: \_\_\_\_\_ Job Location: \_\_\_\_\_ Date: \_\_\_\_\_  
 Prepared by: \_\_\_\_\_ Buyer's Name: \_\_\_\_\_ Quote #: \_\_\_\_\_  
 Job Name: \_\_\_\_\_ Buyer's Address: \_\_\_\_\_

**Model 2010 – 4000 Non-Condensing, 2012 – 4002 Condensing**

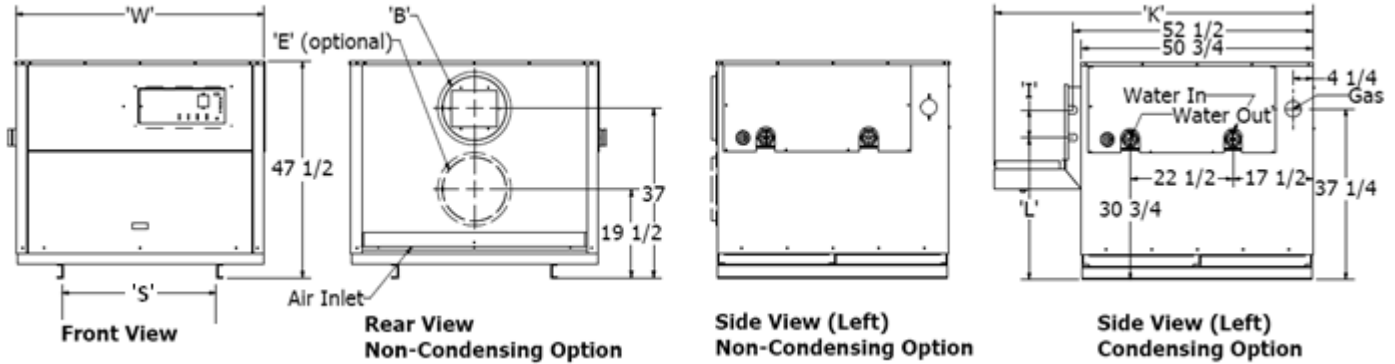

### Input & Output Range

Model	Input Range [kBTU/hr x 100]	Input Range [kW]	Input [BTU/hr]	Input [kW]	Non-Condensing		Condensing	
					Output [BTU/hr]	Output [kW]	Output [BTU/hr]	Output [kW]
2010/2012	800 - 2000	234.2 – 585.6	2,000,000	585.6	1,700,000	497.8	1,900,000	556.3
2500/2502	1000 - 2500	292.8 – 732.0	2,500,000	732.0	2,125,000	622.2	2,375,000	695.4
3000/3002	1200 - 3000	351.4 - 878.4	3,000,000	878.4	2,550,000	746.6	2,850,000	834.5
3500/3502	1400 - 3500	409.9 - 1024.8	3,500,000	1024.8	2,975,000	871.1	3,325,000	973.6
4000/4002	1600 - 4000	468.5 – 1171.2	4,000,000	1171.2	3,400,000	995.5	3,800,000	1,112.6

### Venting

Model	'B' Dia. Venting**			'E' Dia.
	Outdoor	Sidewall or Condensing*	Standard	Air Inlet*
2010/2012	12	12	14	12
2500/2502	14	14	16	14
3000/3002	14	14	16	14
3500/3502	16	16	18	16
4000/4002	16	16	18	16

\*60 Ft Equivalent, Appliance may be provided with two openings which can be combined into this size.  
 \*\* Non-Condensing models are shipped with standard vent opening size unless sidewall venting is specified.

### Dimensions and Specifications

Model	'I'	'K'	'L'	'W'	'S'	Water Connection	Approx. Weight		
							Gas Connection	Non-Condensing [lbs.]	Condensing [lbs.]
2010/2012	6	68	34 5/8	54 5/8	33 3/8	3	1 1/2	1,585	1,635
2500/2502	6	72	34 5/8	78 7/8	58	3	2	1,675	1,745
3000/3002	6	72	34 5/8	78 7/8	58	3	2	1,750	1,820
3500/3502	6	72	34 5/8	103	81 3/4	4	2 1/2	2,000	2,070
4000/4002	6	72	34 5/8	103	81 3/4	4	2 1/2	2,200	2,270

### Heat Exchanger Head Loss & Flow

Model	20°F		30°F		35°F	
	USGPM	ΔP-ft.	USGPM	ΔP-ft.	USGPM	ΔP-ft.
2010/2012	170	5.1	113	2.4	97	1.8
2500/2502	200***	8.2	141	4.3	121	3.3
3000/3002	200***	8.2	170	6.2	146	4.5
3500/3502	200***	10.2	198	10.2	170	7.7
4000/4002	200***	10.2	200***	10.2	194	9.8

\*\*\*Maximum flow recommended. Temperature rise may be higher than shown. Contact factory for recommendations

Model # \_\_\_\_\_ # Of Units \_\_\_\_\_ Type of Gas \_\_\_\_\_

Total Input \_\_\_\_\_ BTU/hr Flow \_\_\_\_\_ USGPM @ Allowable Pressure Drop \_\_\_\_\_ ft.  
 Total Output \_\_\_\_\_ BTU/hr Recovery Rate \_\_\_\_\_ USGPH @ \_\_\_\_\_ °F

Optional Accessories \_\_\_\_\_